

Conversion to Short-Term Rental Permit Life Safety Survey Inspection

After receiving county planning approval, all dwellings used as short-term rentals (rented for not more than 30 days) in unincorporated Larimer County shall obtain a county building permit for conversion to short-term rental, pass a life safety survey and receive a Certificate of Occupancy for the new use.

At a minimum, the life-safety survey shall include, but may not be limited to, the following:

1. Address identification
2. No Unapproved/Unpermitted Uses/Work
3. Observable Structural Concerns
4. Emergency Escape and Rescue Openings
5. Window Wells
6. Smoke Alarms
7. Carbon Monoxide Alarms
8. Fuel Gas Appliances:
 - Approved Locations
 - Dedicated Spaces
 - Required Clearances
 - Combustion Air
 - Approved Venting Systems
 - Temperature/Pressure Relief Valves
 - Proper Condensate Disposal
 - Rooms Fire-Blocked
 - No Ventless fuel gas appliances
9. Home/Garage Separation (Firewalls/Fire doors/Penetrations)
10. Environmental Air Duct Terminations (Bath/Laundry)
11. Handrails
12. Guards
13. Cook Stove Anti-Tip Devices
14. Wildfire Hazard Defensible Space
15. Fire Pits
16. Lighting at Exterior Stairs
17. Ground-Fault Circuit-Interrupter Protection
18. Septic Systems Approved by Health Department
19. Stove-top fire-stop systems
20. Fire extinguishers
21. Operations Manual
22. Signs posted at entrances/exits


International Residential Code sections shown as R319.1, G2406.2, etc. as applicable.

- 1. Address identification - R319.1** Address numbers shall be plainly visible and legible from the Right-of-Way (ROW). If the house cannot be seen from the ROW, the address numbers must be displayed at the driveway turnoff. Address numbers shall contrast with their background and be a minimum of 4" high with a minimum stroke width of 1/2".



2. No Unapproved/ Unpermitted Uses/Work

Property research done as part of the short-term rental application will determine if any work was done without a permit. If so, a separate as-built permit and inspection approvals must be obtained. The county inspector will use the floor plan approved as part of the building permit to verify all rooms are used for their identified purposes, including the designated bedrooms. If more unpermitted work is discovered during the Life-Safety Survey, additional permitting will be required.

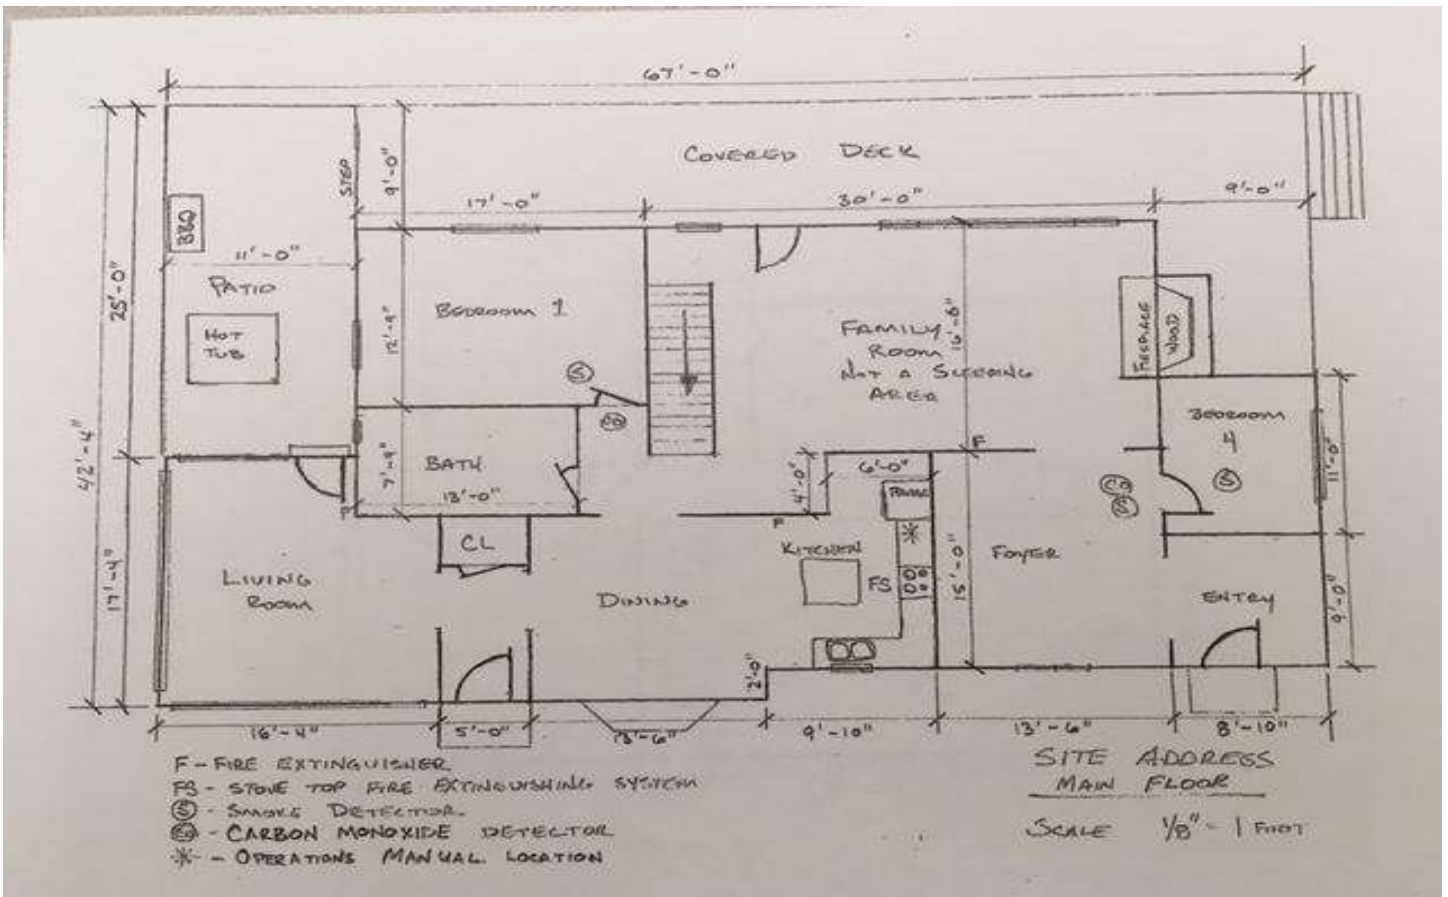

3. Observable Structural Concerns – Such concerns include hot tubs on decks not originally designed for hot tubs and additions not properly framed or supported. Visual indicators such as missing point loads, inadequate deck connections or foundations shifting over time can also be concerns. Work not permitted may also present a structural or life safety concern.




Unsafe deck beams, posts, footings, and rails.



Unsafe connections to beam, ledger.



Missing point loads in the crawl space

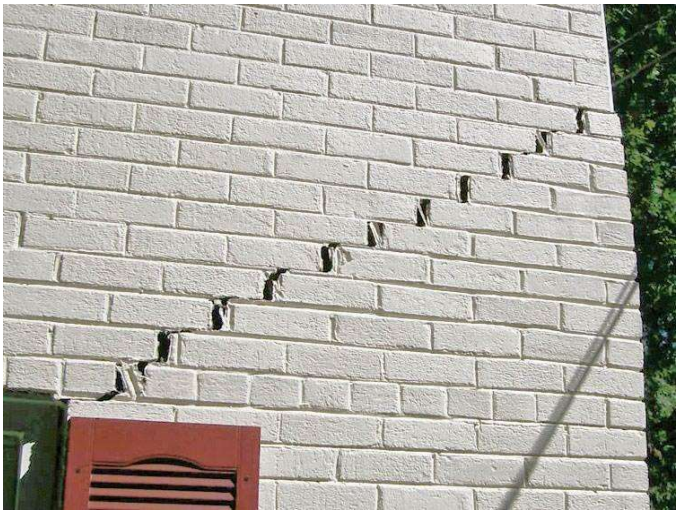


Stair-step cracking


4. Emergency Escape/Rescue Openings (EE&RO) in all sleeping rooms

R310.1 Emergency escape and rescue openings shall be openable from the inside without the use of a tool, key or special knowledge. Windows requiring sash removal or manipulation do not comply.

R310.2.1 All emergency escape and rescue openings shall have a minimum net clear opening of 5.7 sq. ft. (820.8 square inches), a minimum clear width of 20" AND a minimum clear height of 24". [Using minimum width AND height will yield a window opening less than the minimum allowed. A 20" wide opening must open 41" high, and a 24" high opening must open 34 3/16" wide to make 5.7 sq. ft.]


R310.2.2 The EE&RO sill shall be no higher than 44" above the finished floor.

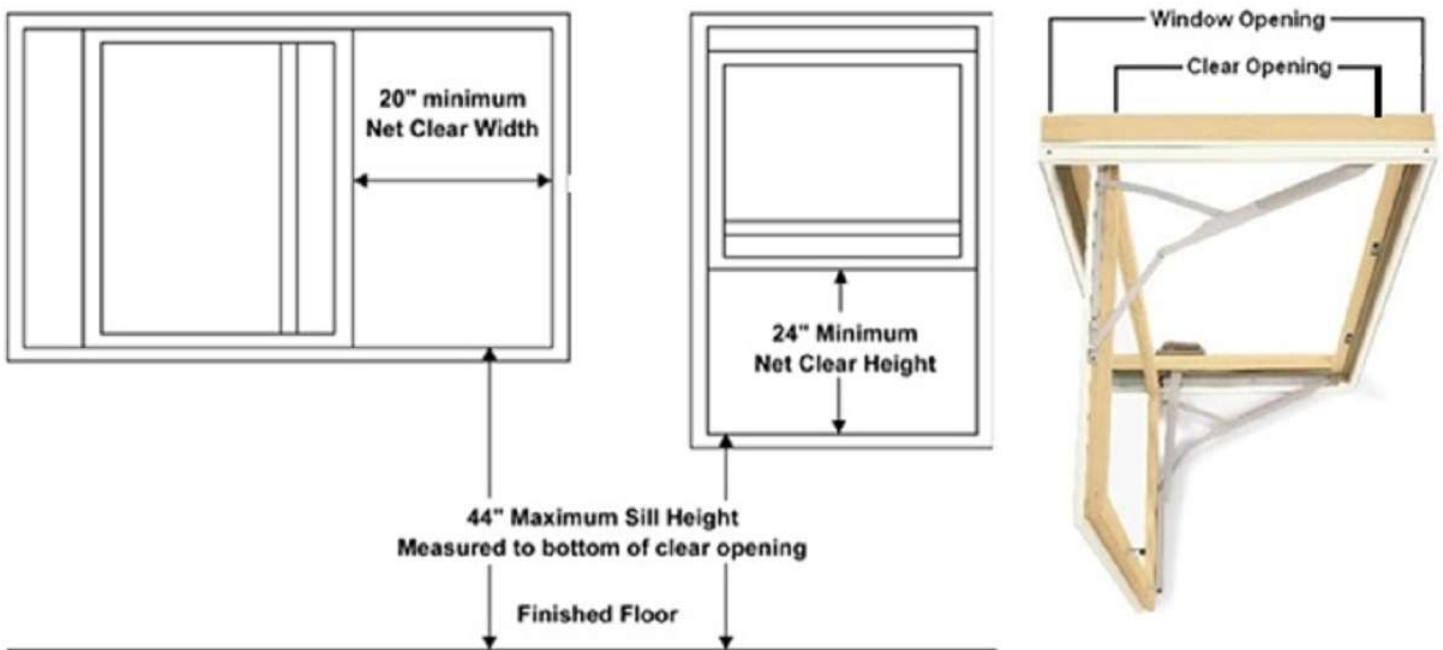

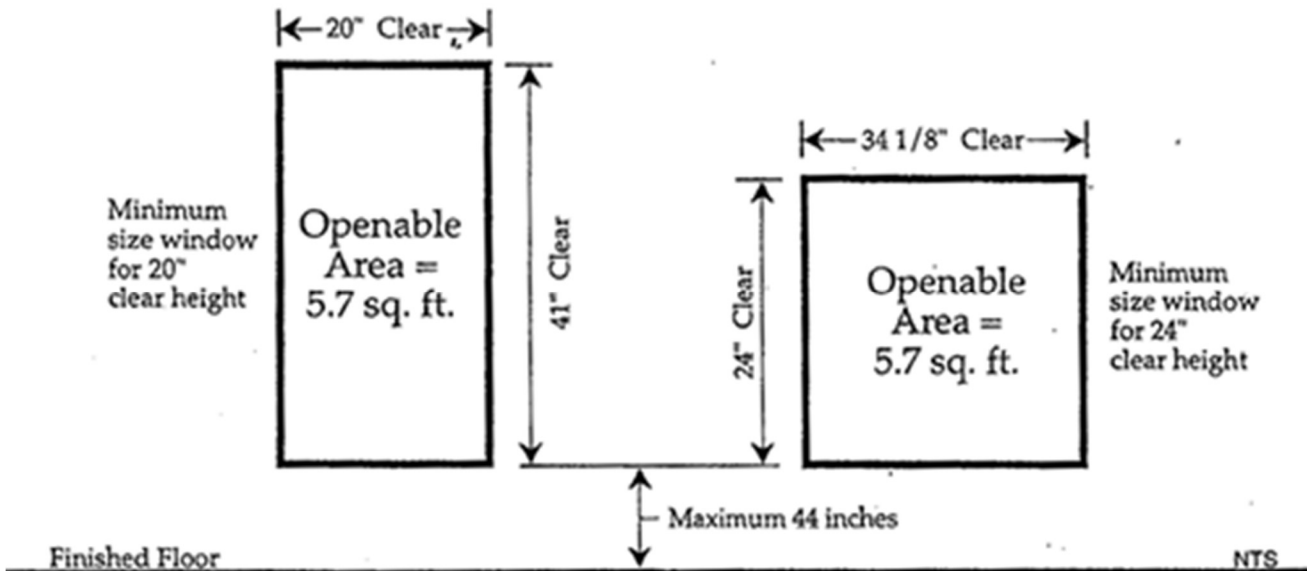

5. Approved Window Wells at below-grade emergency escape and rescue openings

R310.2.3 The horizontal area of the window well shall be not less than 9 sq. ft. with a horizontal projection and width of not less than 36". Casement windows shall not encroach into the required window well dimensions.

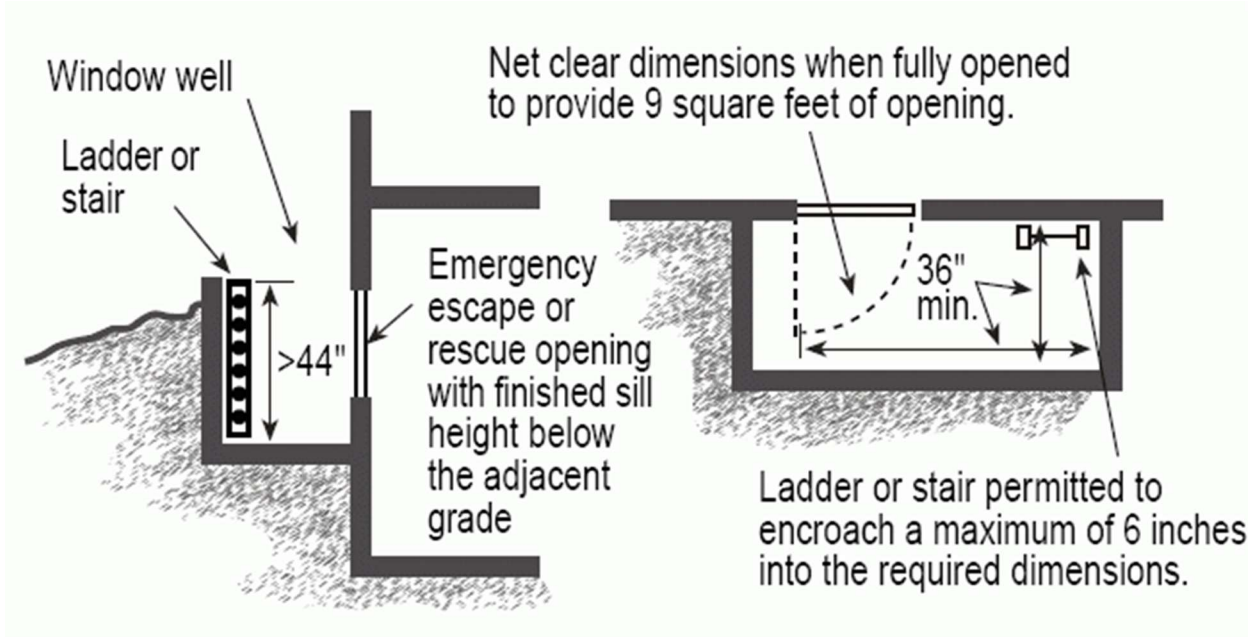

6. Approved Smoke Alarms at all required locations

R314.1 Smoke alarms shall comply with NFPA 72 and be listed per UL 217.

(Combination smoke/CO alarms are permitted and must be listed per UL 217 and UL 2034.)

Installation manuals must be on site. Smoke alarms must be functional and interconnected.

R314.3 Smoke alarms shall be installed in the following locations:

- In each sleeping room or space;
- Outside each separate sleeping area in the immediate vicinity of sleeping rooms;
- On each additional story, including basements and habitable attics.

Smoke alarms shall not be located within 3' horizontally from a door or opening of a bathroom containing a bathtub or shower unless this would prevent placement of the required smoke alarm. They must be located at least 3' from diffusers & vents.

R314.3.1 Installations near permanently installed cooking appliances:

- Ionization smoke alarms shall not be installed within 20' horizontally from such appliances.
- Ionization smoke alarms with an alarm-silencing switch shall not be installed within 10' horizontally.
- Photoelectric smoke alarms shall not be installed within 6' horizontally.

Smoke alarms must be powered by the home electrical system with a battery backup.

When using smoke detectors as part of a fire alarm system, they must be listed per UL 268.

Combination smoke/CO detectors must be listed per UL 268 and UL 2075.

NFPA 72 (2007 edition) gives further guidance on the placement of smoke detectors, including:

Smoke alarm rough-ins for flat ceilings are at least 4" from adjoining walls.




Smoke alarm rough-ins for peaked or sloped ceilings are at least 4" from the ceiling peak and are within 36" horizontally of the ceiling peak.

Smoke alarms shall not be located within three feet of the supply registers of a forced air furnace.

In unfinished construction, alarms should be mounted on the bottom of the floor joists.

Smoke alarms in a room with a ceiling sloped greater than one foot vertical in eight feet horizontal are to be located on the high side of the ceiling.



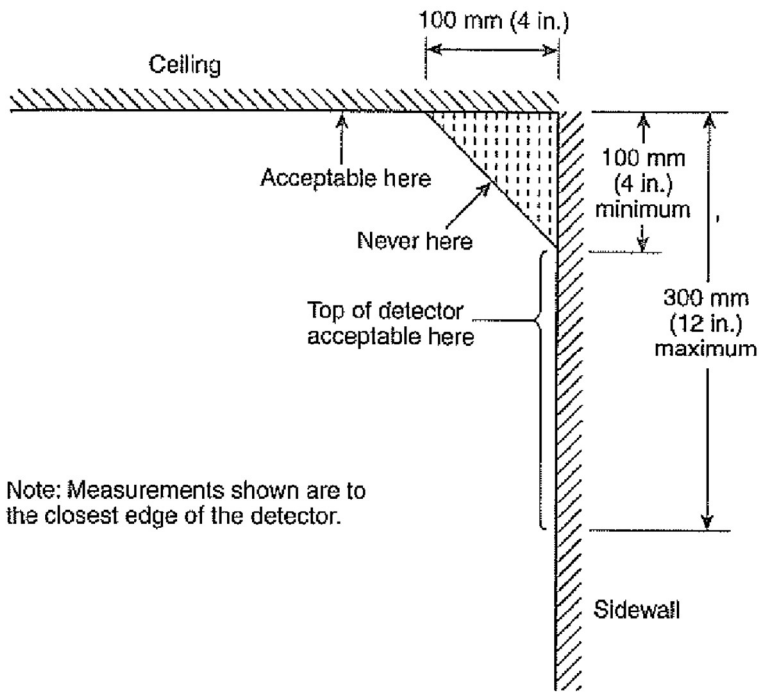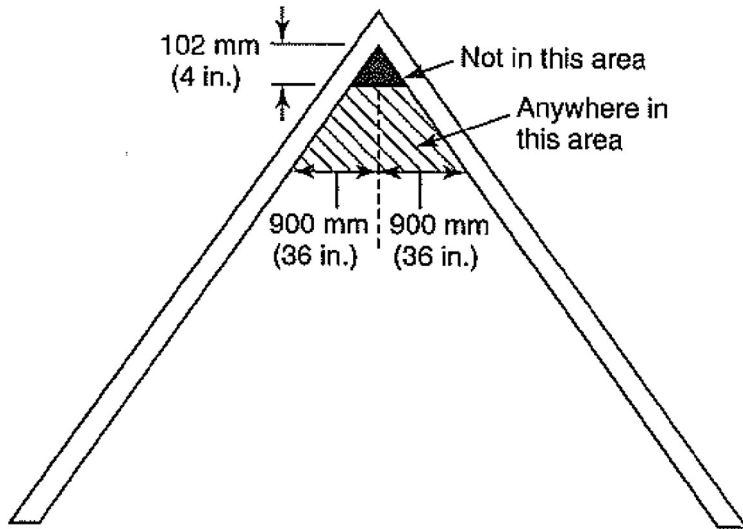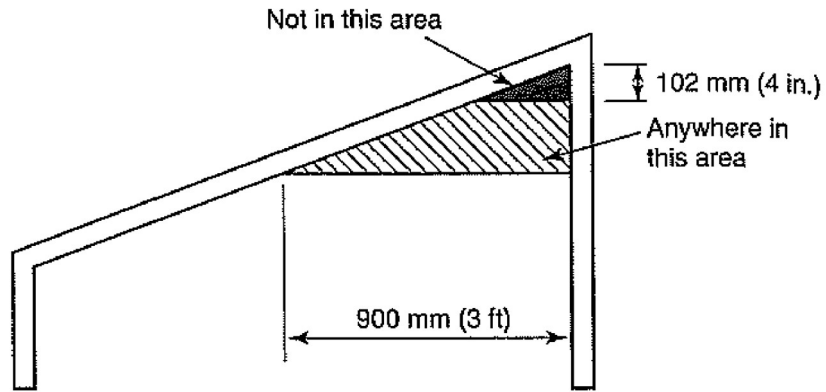

Note: Measurements shown are to the closest edge of the detector.

7. Approved Carbon Monoxide Alarms at all required locations -

R315.1.1 Carbon monoxide (CO) alarms shall be listed per UL 2034.

R315.2.1 CO alarms shall be provided where either or both of the following conditions exist:

- The dwelling unit contains a fuel-gas or solid fuel appliance;
- The dwelling unit has an attached garage with a communicating opening to the dwelling unit.

R315.3 CO alarms shall be located outside of each separate sleeping area in the immediate vicinity of bedrooms and within 15' of the door of each bedroom.

CO alarms are installed within bedrooms that contain a fuel gas appliance or where a fuel gas appliance is located in a bathroom attached to the bedroom.

CO alarms must be powered by the home electrical system with a battery backup.

Signs of a good night out? Or carbon monoxide poisoning?



HEADACHES



NAUSEA



BREATHLESSNESS





COLLAPSE



DIZZINESS




LOSS OF
CONSCIOUSNESS

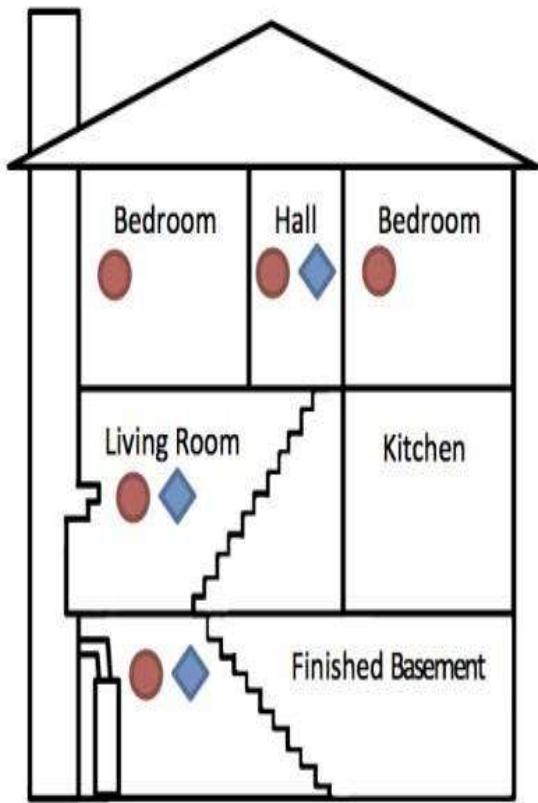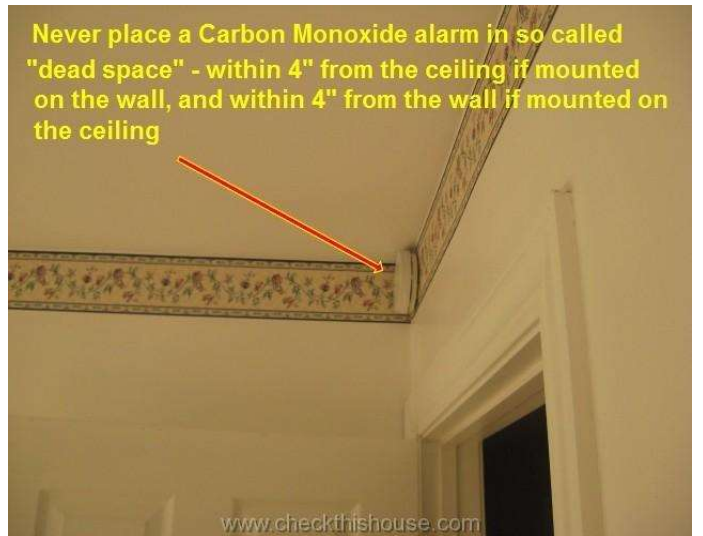

Multi Story Residence

KEY	
	Smoke Alarms
	CO Alarms
	Both or Combination

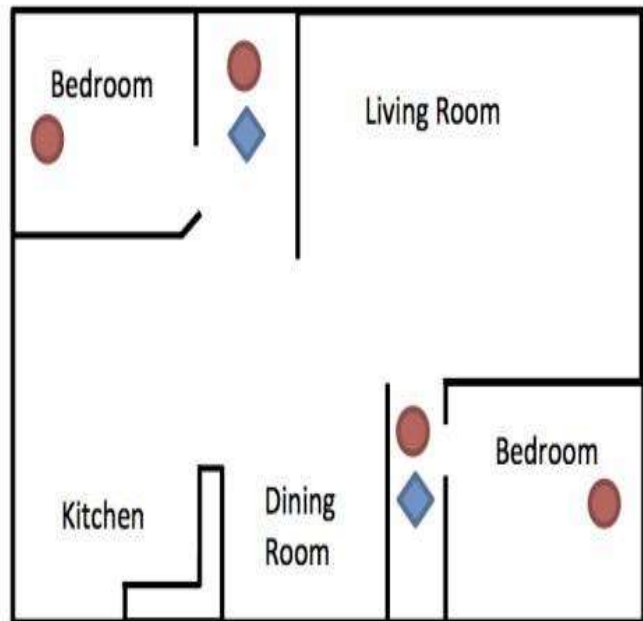

Single Story Residence

8. Fuel Gas Appliances - The manufacturer's installation instructions must be available on site for review to verify the appliance has been installed in accordance with the manufacturer including but not limited to location, protection, clearances to combustibles, clearances for servicing, volume of combustion air available, venting, shutoff valves, and proper gas piping.



G2406.2 Prohibited Locations (Amended):

Appliances shall not be located in sleeping rooms, bathrooms, toilet rooms, storage closets or in a space that opens only into such rooms or spaces, except where the installation complies with one of the following:

1. The appliance is a direct-vent appliance installed in accordance with the conditions of the listing and the manufacturer's instructions.
2. Vented room heaters, wall furnaces, vented decorative appliances, vented gas fireplaces, vented gas fireplace heaters and decorative appliances for installation in vented solid fuel-burning fireplaces are installed in rooms that have a volume of at least 50 cubic feet per 1,000 Btu/h of the appliance input rating.
3. The appliance is installed in a room or space opening only into the bedroom or bathroom, the room

is used for no other purpose, is equipped with a solid, self-closing weather-stripped door and all combustion air is taken directly from the outdoors.

4. A clothes dryer installed in a bedroom or bathroom has a permanent opening of at least 100 square inches communicating with a space outside of a bedroom, bathroom or closet.

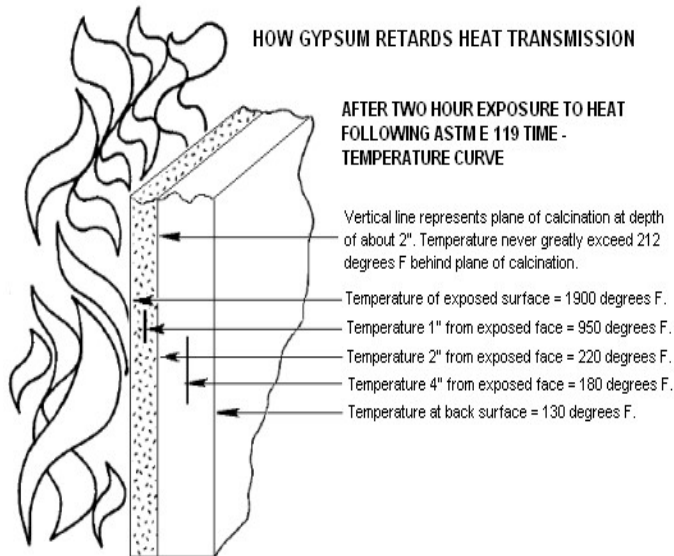


Table G2427.10.5 Clearances from the vent or connector to combustibles shall be as listed for the B-vent connector (usually 1" minimum) and a minimum of 6" for a single-wall connector.

R602.8; R302.11 Fireblocking of openings and penetrations within the mechanical room or closet is required.

9. Home/Garage Separation (including attic access)

R302.6 Dwelling/garage fire separation. An attached private garage shall be separated from the dwelling unit and its attic area by means of a minimum 1/2-inch (15.9 mm) Type X (fire-resistant) gypsum board applied to common walls on the garage side. The gypsum must run from top of foundation to the underside of the roof deck or to the garage ceiling and then run horizontal on the entire ceiling to the outside walls.



(Data from Underwriters Laboratories, Inc.)



Garages beneath habitable rooms shall be separated from all habitable rooms above by not less than 5/8-inch (15.9 mm) Type X (fire-resistant) gypsum board or equivalent. Ceiling beams must be wrapped in 5/8" Type X gypsum, while bearing walls/structural elements supporting the floor above require minimum 1/2" gypsum.




R302.5.1. Door openings between a garage and the dwelling unit shall be equipped with either solid wood or solid or honeycomb-core steel doors not less than 1-3/8 inches thick, or minimum 20-minute rated fire doors. Doors shall be self-closing and self-latching. Direct openings from a garage into a sleeping room are prohibited.

R302.2 Dwelling unit separations will be inspected to verify compliance with fire resistance requirements in duplexes, townhomes and mixed occupancy spaces.



Some penetrations will be easy to remediate.

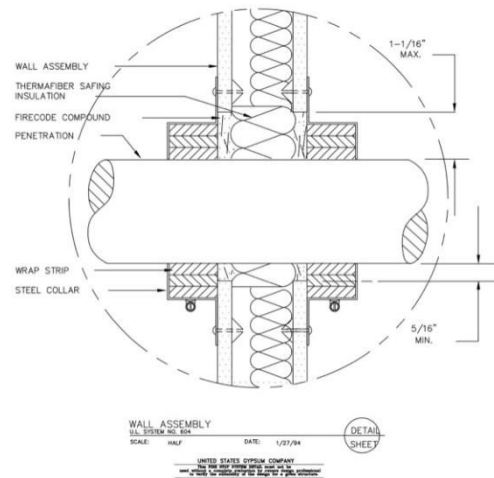

Some separations may require more extensive remediation. Fire-rated walls separating duplexes, townhouses, and different occupancies must be continuous from top of foundation to underside of roof decking, from exterior wall to exterior wall, and all penetrations must be fire-protected. In this case, a contractor was hired to finish the drywall installation on the exposed side in the photo and install fire collars on both sides of the wall at the pipe penetrations.

10. Environmental Air Duct Terminations - R101.3, M1502.3 Dryer exhaust vent is terminated on the outside of the building, located a minimum of 3' from openings, provided with a backdraft damper only and is not located over a public sidewalk. No screens cover the exhaust termination.



M1502.1 Clothes dryers shall be exhausted in accordance with the manufacturer's instructions.
M1502.4.1, M1502.4.2 The clothes dryer exhaust duct is 4" in diameter, a minimum of 28 gage rigid metal, with a smooth interior, joints running in direction of air flow and no fasteners protruding inside the duct. Flexible transition duct is allowed in the laundry room only, before entering any walls, floors or ceilings. Dryer duct run length is restricted by code (35 feet minus duct fittings) and the manufacturer's installation instructions, whichever is more restrictive.

11. Handrails and 12. Guards

R311.7 Handrail projection permitted up to 3 1/2" into stair width with 1 1/2" clearance behind handrail.

R311.7.8.1 Handrails are located between 34" and 38" above tangent of nose of treads.

R312.1 Guards are located along open-sided walking surfaces, including stairs, ramps and landings that are more than 30" to the floor or grade below at any point within 36" horizontally to the edge of the open side.

R312.1.2 Required guards are not less than 36" in height.

Exception: Guards used as handrails are between 34" and 38" above tangent of nose of treads.

R312.1.3 Openings in required guards between rails or ornamental closures do not allow 4" diameter sphere to pass through.


Exception:

1. Maximum 6" sphere cannot pass through at riser/tread triangle along open stairs.
2. Guards along the open side of stairs do not allow a 4 3/8" sphere to pass through openings.



13. Cook Stove Anti-Tip Device – R106.1.2 The anti-tip device for the free-standing oven has been installed as per the manufacturer's installation instructions.

Do you have a freestanding range?

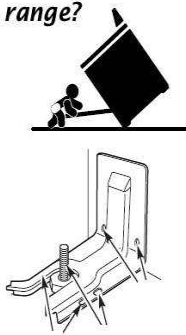

Anti-tip brackets have been required since 1988; however they require special installation procedures which homeowners and/or non-certified installers may disregard.

**Please, check all ranges to see that they can not tip over
Anti-tip kits are cheap and easy to install**



14. Wildfire Hazard Defensible Space

R325.13 Maintenance. Defensible space areas created as required by this chapter or other referenced documents within the Larimer County Wildfire Mitigation Plan are to be maintained by the property owner. No re-planting or new planting of trees, shrubs or other vegetation that would violate the defensible space requirements of this section shall be permitted.




15. Exterior Fire Pits –

New solid-fuel fire pits are not allowed for Short-term rentals in the Wildfire Hazard Area. Existing solid-fuel fire pits must be locked off so short-term renters cannot use them. Gas fire-pits are allowed but must be permitted, inspected and approved, including the gas line, shutoff valve, metal or masonry fire ring, and clearance to the home and to combustibles (brush, grasses, trees, etc.)



16. Interior and exterior stairways should be provided with an artificial light source.

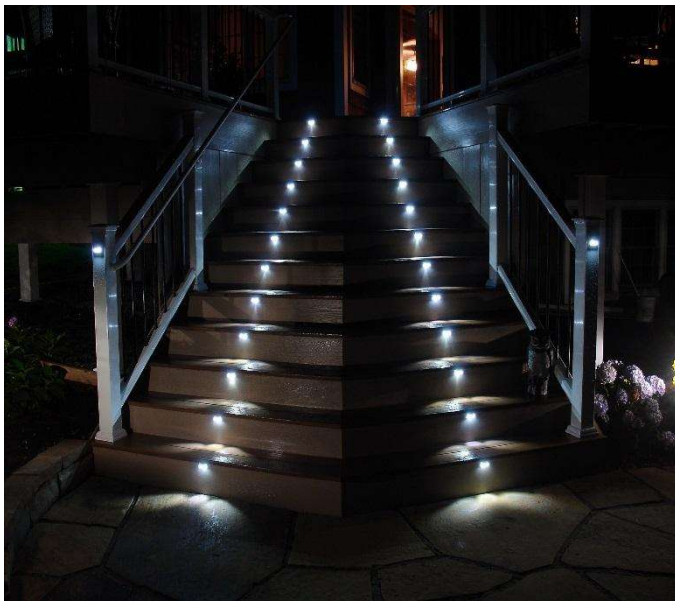


17. Ground-Fault Circuit-Interrupter (GFCI) Protection - A GFCI monitors the amount of current flowing from hot to neutral. If there is any imbalance, it trips the circuit. If electricity flows from hot to ground through you, it could be fatal. The GFCI can sense the current flowing through you because not all of the current is flowing from hot to neutral as it expects -- some of it is flowing through you to ground. As soon as the GFCI senses that, it trips the circuit and cuts off the electricity.

GFCI Receptacle (*Ground Fault Circuit Interrupter*)

GFCI receptacles are required when wiring:

- Garages
- Outdoors
- Kitchens
- Bathrooms
- Crawl Spaces
- Unfinished Basements

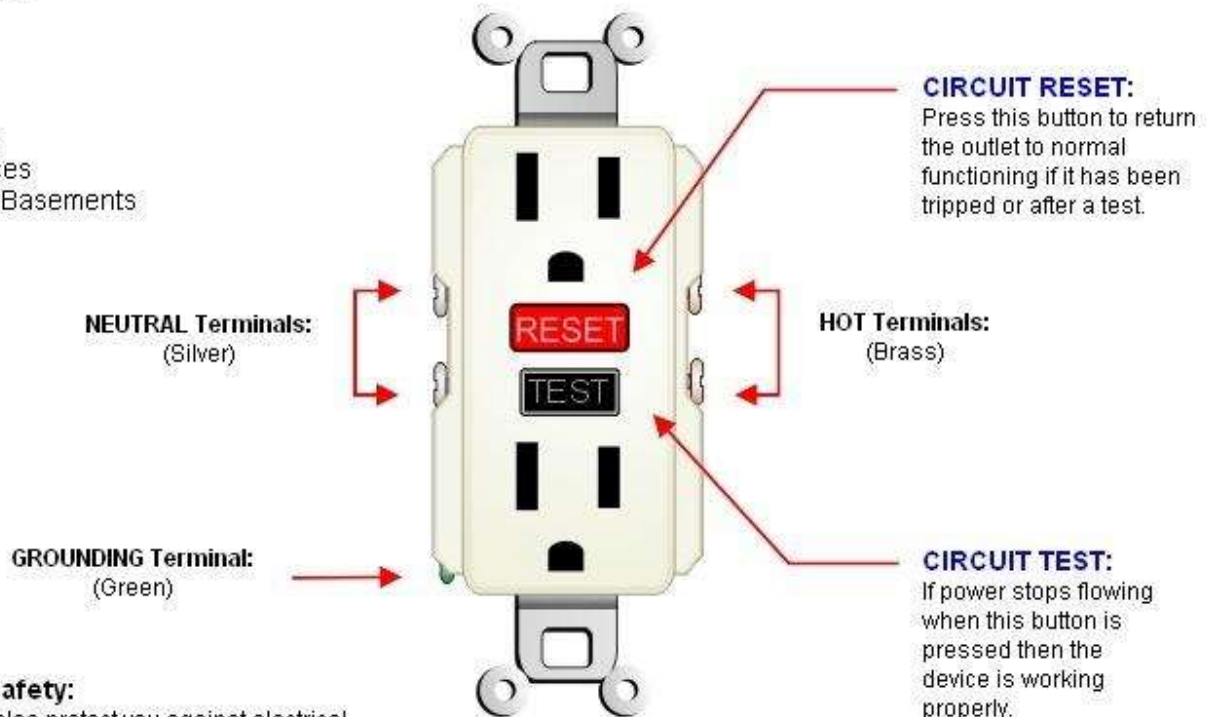


For Your Safety:

GFCI receptacles protect you against electrical shock that can be caused by moisture, faulty electrical equipment and cords.

18. Septic Systems Approved by Health Department

A septic System or OWTS (On-site Wastewater Treatment System) is a self-contained, underground wastewater treatment system, most often utilized in rural areas. State/county laws require a permit be issued by the county Health Department prior to constructing or making repairs to a septic system.

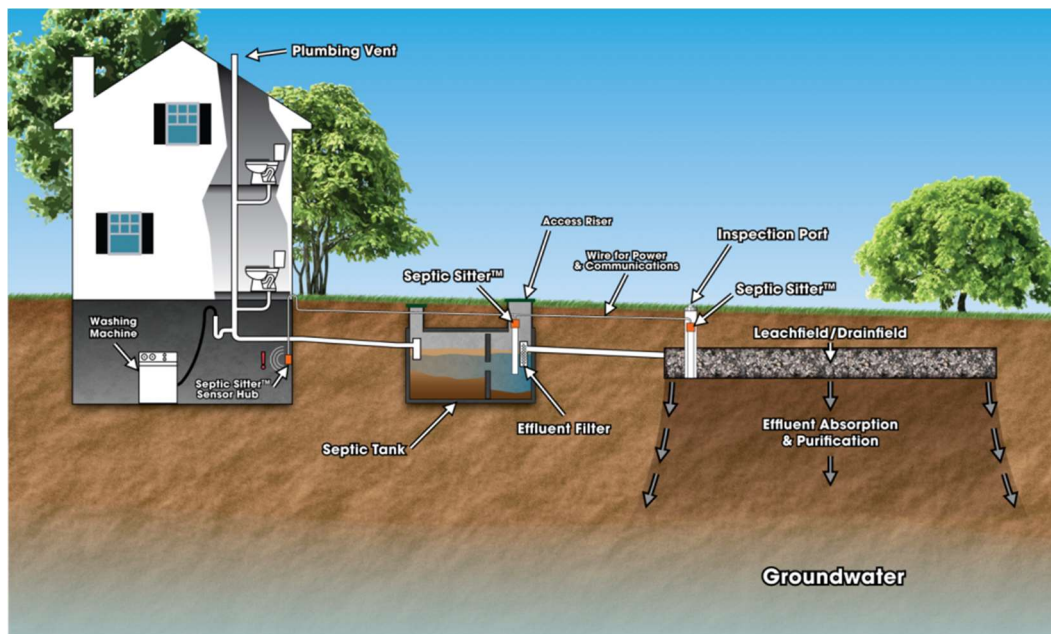

Septic system size is based on the number of bedrooms. Increasing the occupant load without addressing the septic system's capacity may result in system failure.



For information regarding OWTS permits, guideline documents and resources, please reference <http://Larimer.org/health/ehs/isds.asp>.

19. Stove-top fire-stop systems

An approved automatic fire-extinguishing system shall be installed above each stove, range or cooktop in accordance with the fire-extinguishing system manufacturer's installation instructions.

Many manufacturers make these stand-alone systems, including "Stovetop," "Range Queen" and others, with costs as low as \$50 per unit. They will not cover the entire home like a fire sprinkler will, but they can quickly put out a cooking appliance fire, which is one of the most common sources of home fires.



20. Portable fire extinguishers

Unless the home has a functioning fire sprinkler system, fire extinguishers with a minimum rating of 1-A; 10-B; C shall be installed in a conspicuous location where they will have ready access and be immediately available for use in the following locations:



- a. In each room with a cooking appliance, fireplace, heating appliance or water heater.
- b. Inside and adjacent to the door leading to a deck, porch or patio with such appliances.
- c. At least one on each floor.



21. Operations Manual

An operations manual shall be provided in a readily visible location such as on the kitchen counter or at the land-line phone. At a minimum, the manual shall contain the following items:

- 1) the address, GPS coordinates and phone number of the short-term rental;
- 2) exit mapping from each habitable room in the house;
- 3) a map of escape routes from the neighborhood to a public road;
- 4) contact information and a copy of current registration with the Fire Department having jurisdiction, as well as contact information for Police/sheriff and ambulance service;
- 5) contact information for the owner or manager with a response time of 60 minutes or less;
- 6) the location of and instructions for emergency shutoff of water, gas and electrical systems;
- 7) information on the stove-top firestop and fire extinguishers;
- 8) information on Wildfire Hazard Area concerns;
- 9) the location of property lines and instructions to prevent trespass on neighboring properties;
- 10) instructions on safe interaction with wildlife, trash disposal and noise considerations.

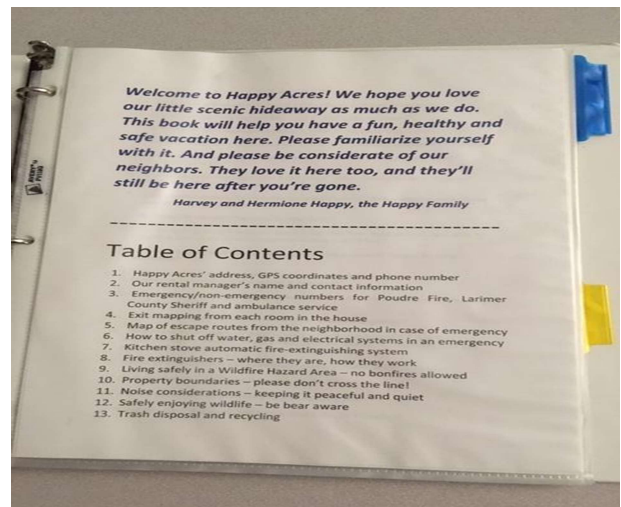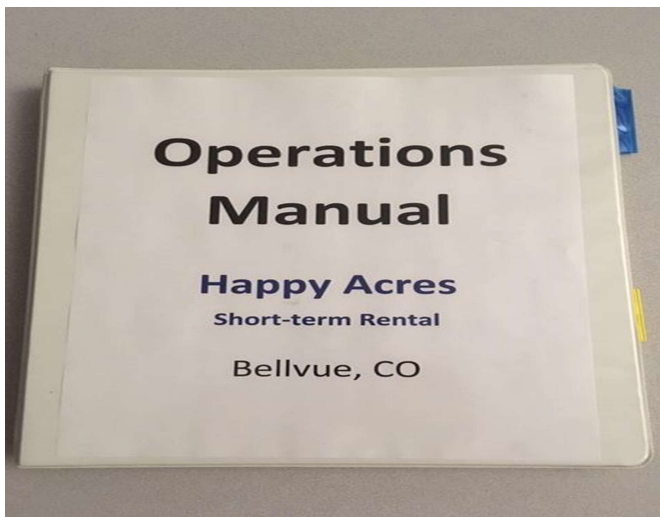

22. Signs posted at entrances/exits

A sign containing the information noted in Item 21 (items 1 through 5) shall be posted at each exterior door of the home.

